Approved For Release 2001/03/06 : CIA-RDP78B04747A000400030043-8

25X1A

[redacted]

25X1A

REGISTERED

26 OCT 1964

[redacted]

25X1A Attention: [redacted]

25X1A Subject : Contract No. [redacted]
Security Requirements

Gentlemen:

Reference is made to the recent conversations between your personnel and representatives of our Security Staff and Contracts Branch regarding security requirements in connection with Contract
25X1A No. [redacted]

In addition to the security modifications which have been effected at your plant the following additional measures will be required:

a. The approved safe file, now installed in the office area of Laboratory No. 6, must be moved to an area where it will be visible from the door inspection port. (It is our
25X1A understanding that this has been done following the recent visit to your plant by [redacted] of this office, but it is requested that this be confirmed in writing).

b. The existing wooden door to the Laboratory must be covered with nine (9) gauge expanded metal and provided with an inspection port no larger than ninety-six (96) square inches with a clear glass pane and a suitable curtain or cover which will preclude visual observation of the working area during business hours.

c. The existing Masonite walls and the Masonite walls to be erected when the vault area is expanded must be covered with nine (9) gauge expanded metal from floor to ceiling. It will not be necessary to place expanded metal on the ceiling.

CONFIDENTIAL

Excluded from automatic downgrading and declassification

Approved For Release 2001/03/06 : CIA-RDP78B04747A000400030043-8

Approved For Release 2001/03/06 : CIA-RDP78B04747A000400030043-8

No fabrication of the equipment can be initiated until the foregoing requirements are complied with nor may the area be used for storage of classified material too large for storage in the approved safe file in Laboratory No. 6.

When the above modifications have been effected, please advise this office and arrangements will be made for a reinspection by a representative of the Security Staff.

Very truly yours,

25X1A [redacted]

Contracting Officer

Distribution:
Orig. - Addressee
1 - File [redacted]
1 - Vital Records
~~1 - Rec. Desk # 2~~
~~1 - SD/DSCB~~
1 - Regn. Office (NPIC)
1 - SS/OL
~~1 - ICS/Chrono~~

25X1A OL/PD/CB/ICS [redacted] /2383
(20 October 1964)

Approved For Release 2001/03/06 : CIA-RDP78B04747A000400030043-8

25X1A
Approved For Release 2001/03/06 : CIA-RDP78B04747A000400030043-8

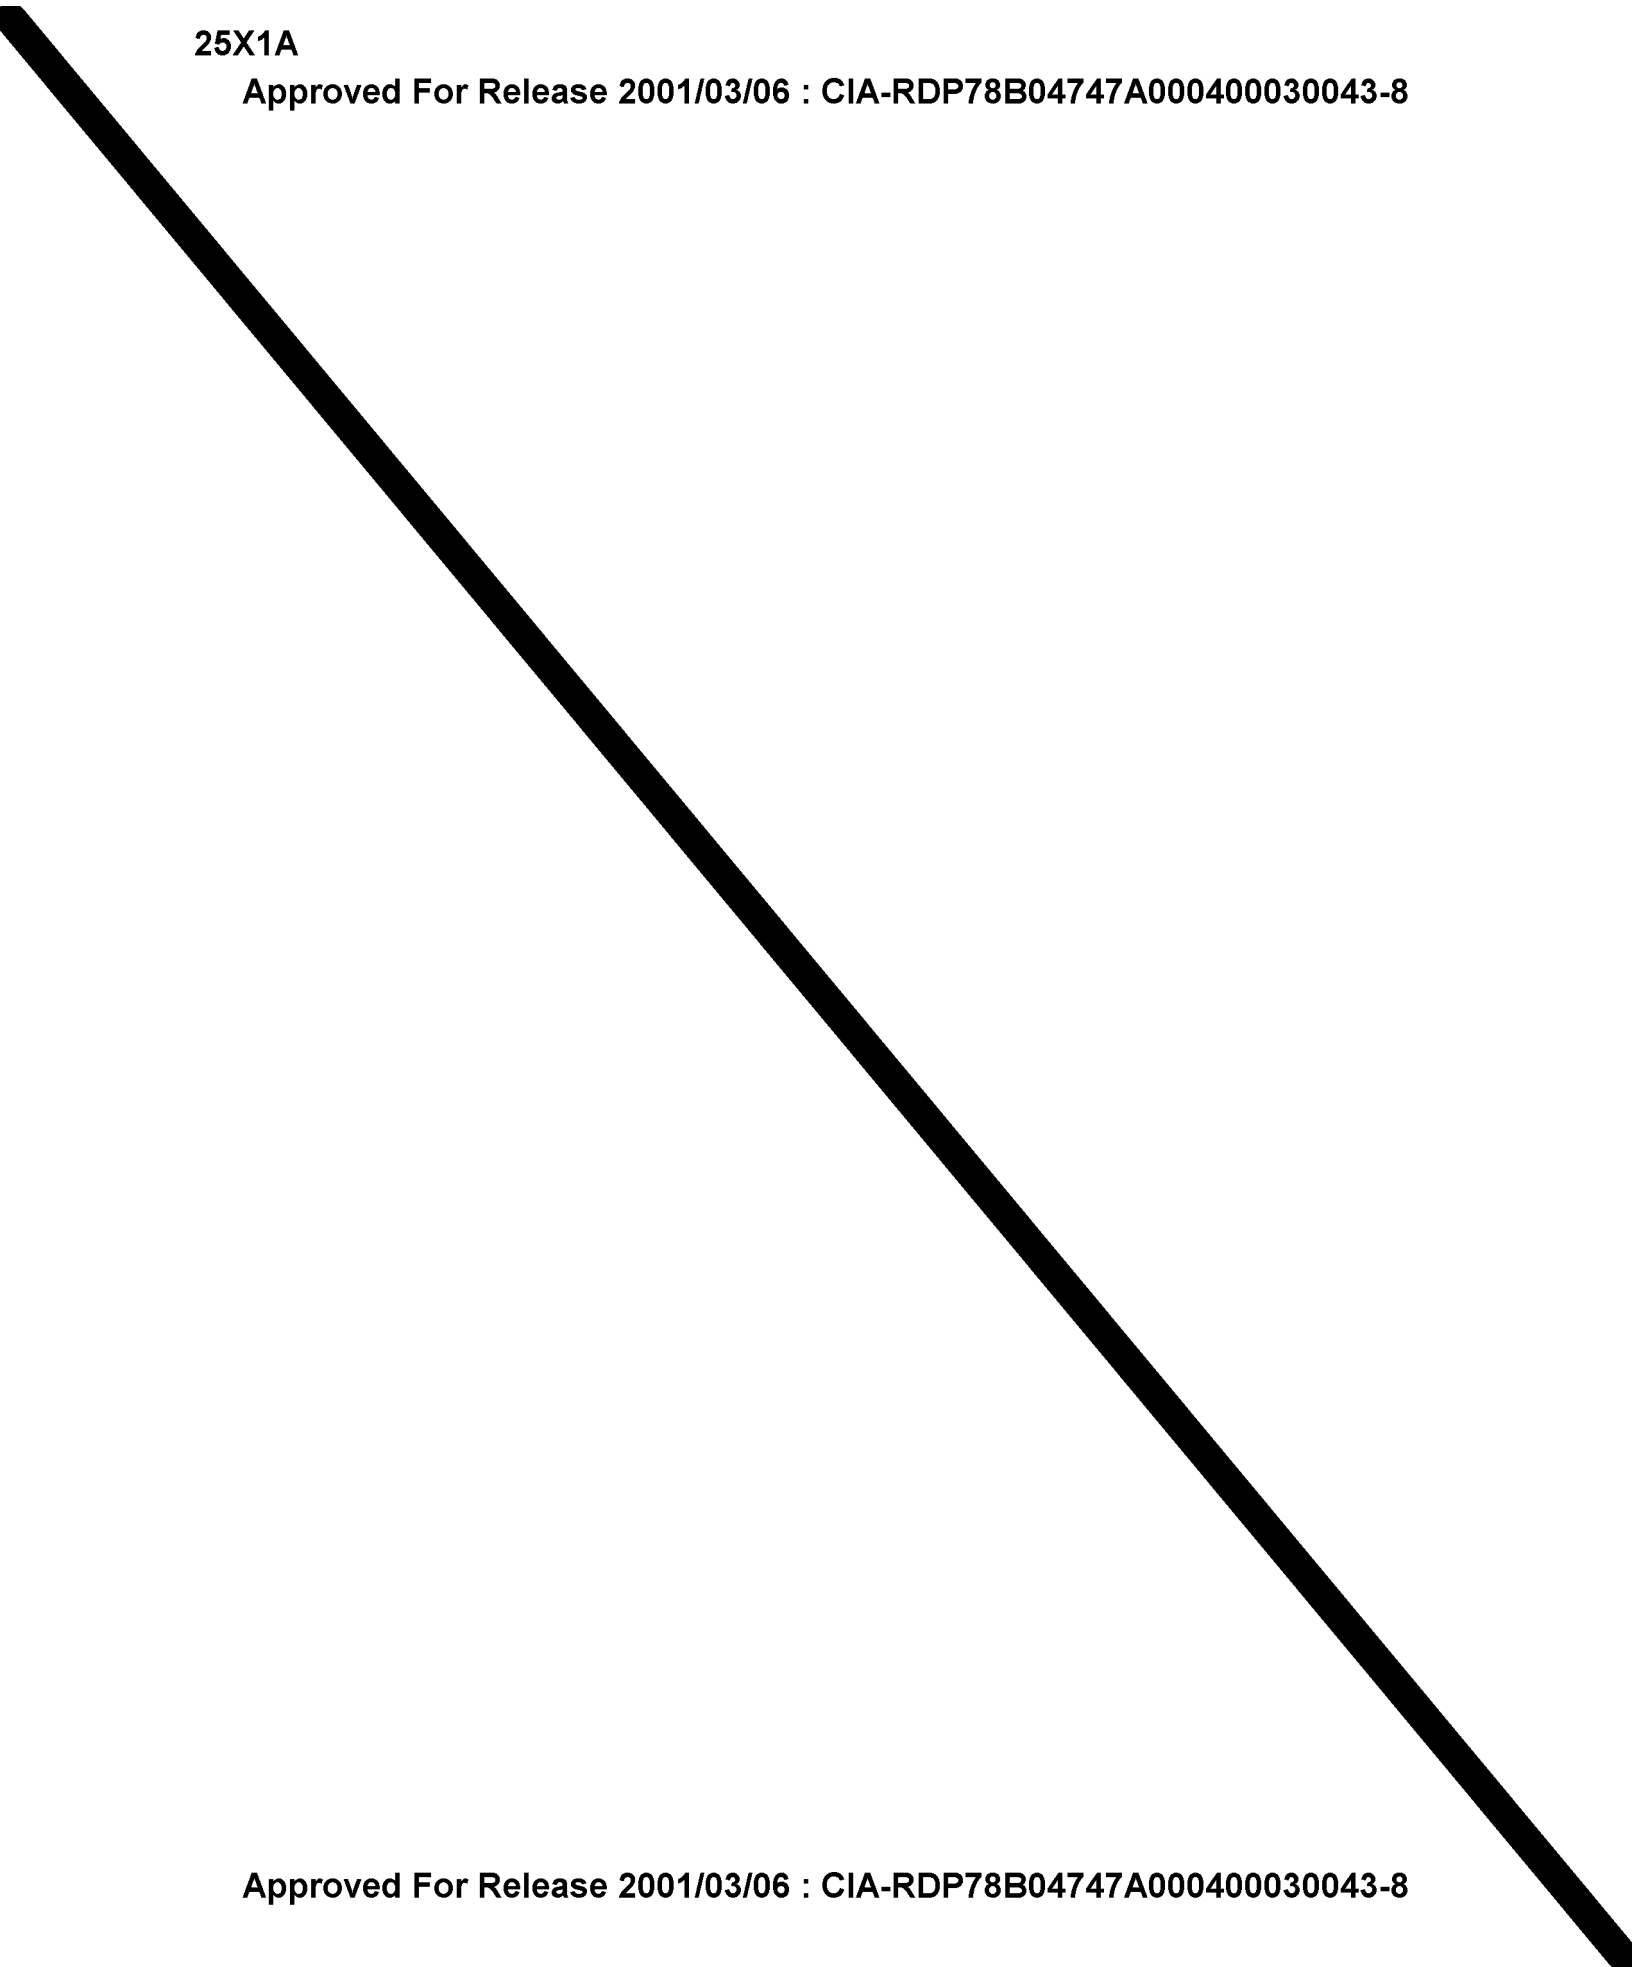

Approved For Release 2001/03/06 : CIA-RDP78B04747A000400030043-8